


Number of Failed Inspections in Tobacco Retail Outlets by Census Tract, Kansas City, Kansas, November 2017

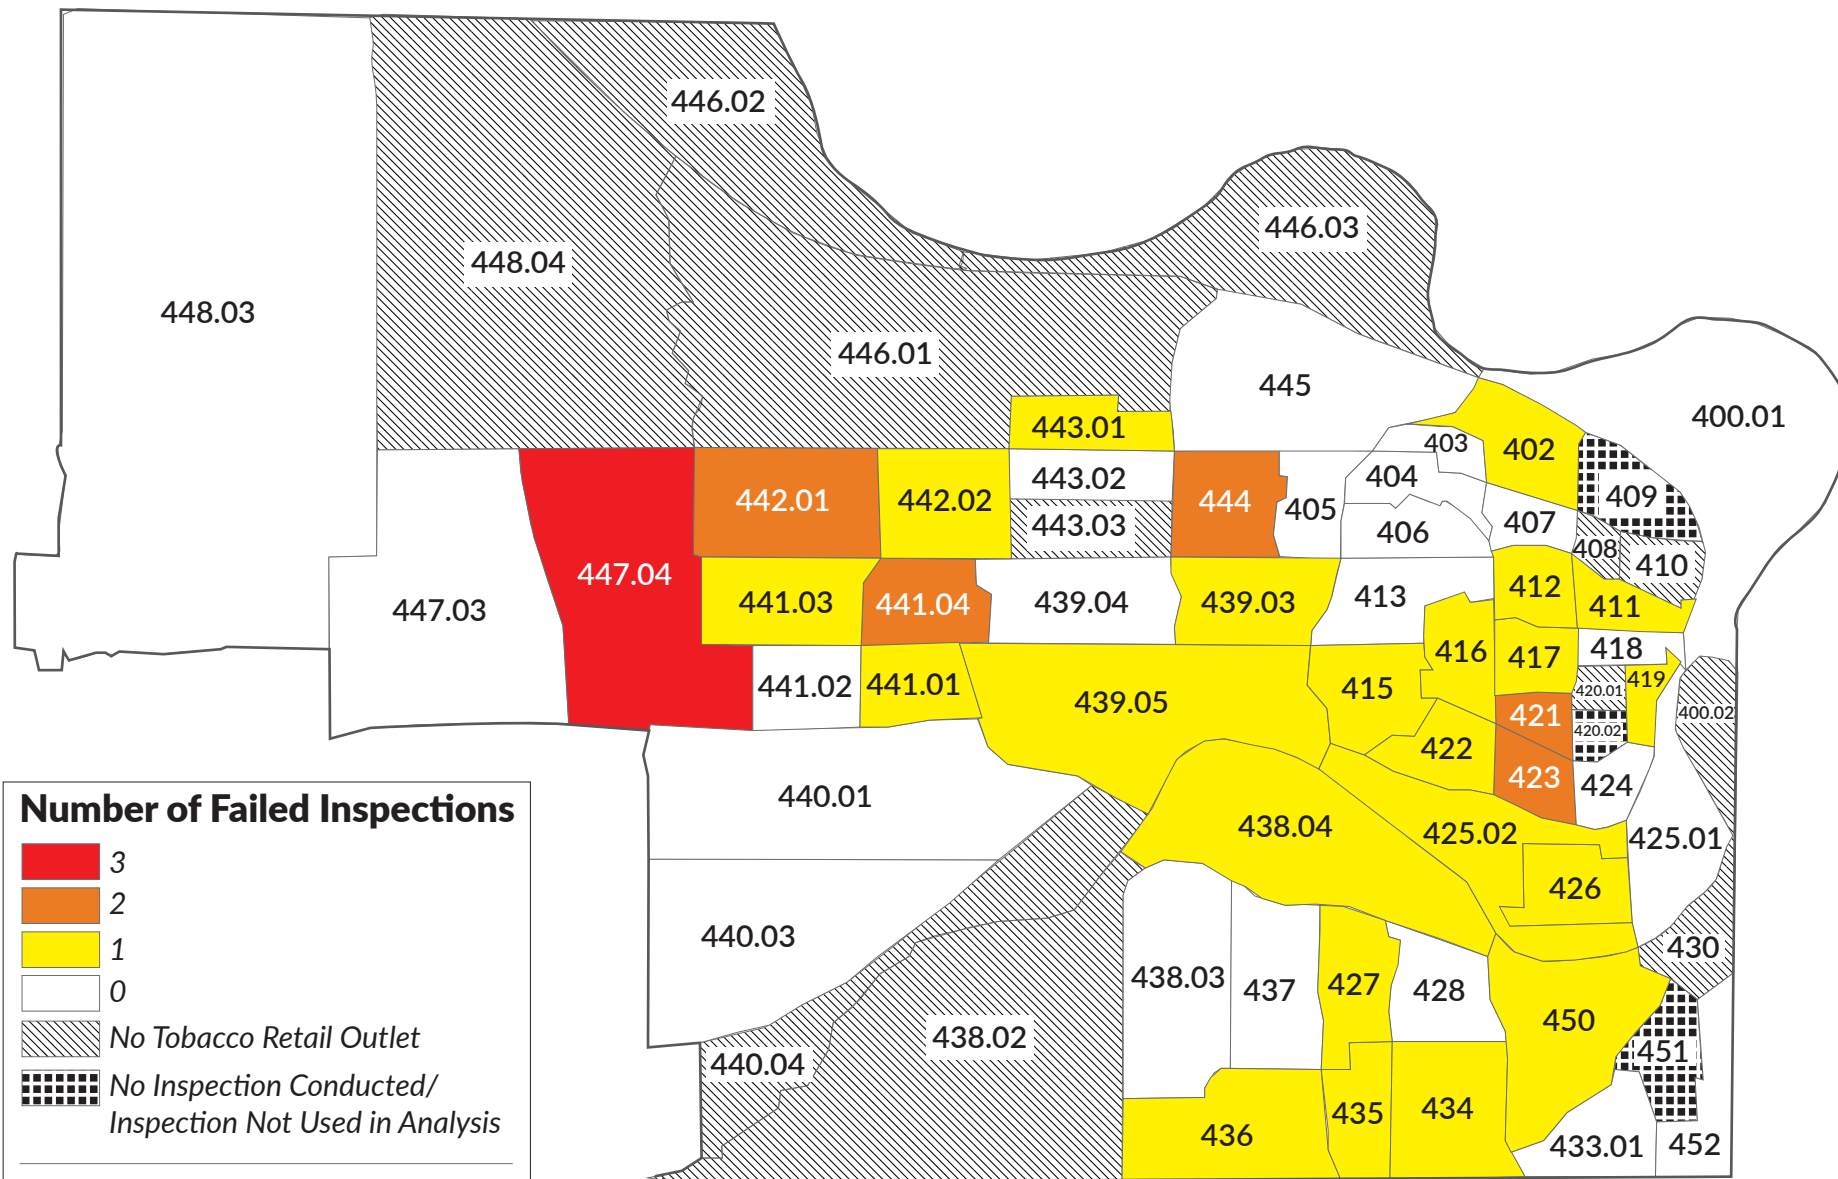

Note: Of the 129 tobacco retail outlets (“retailers”) inspected in this study, 91 were revisited for an inspection up to three times. Two measures were used to examine retailer compliance: Overall Failure Rate was computed as the number of failed inspections (35) divided by the number of total completed inspections (272); and Retailer Violation Rate was computed as the number of retailers in violation (32) divided by the number of retailers with at least one inspection (129).

Source: Kansas Health Institute analysis of data from the U.S. Census Bureau and the 2017 Kansas City, Kansas, Enforcement Study.